


SPARK DETECTOR SYSTEM

system diagram

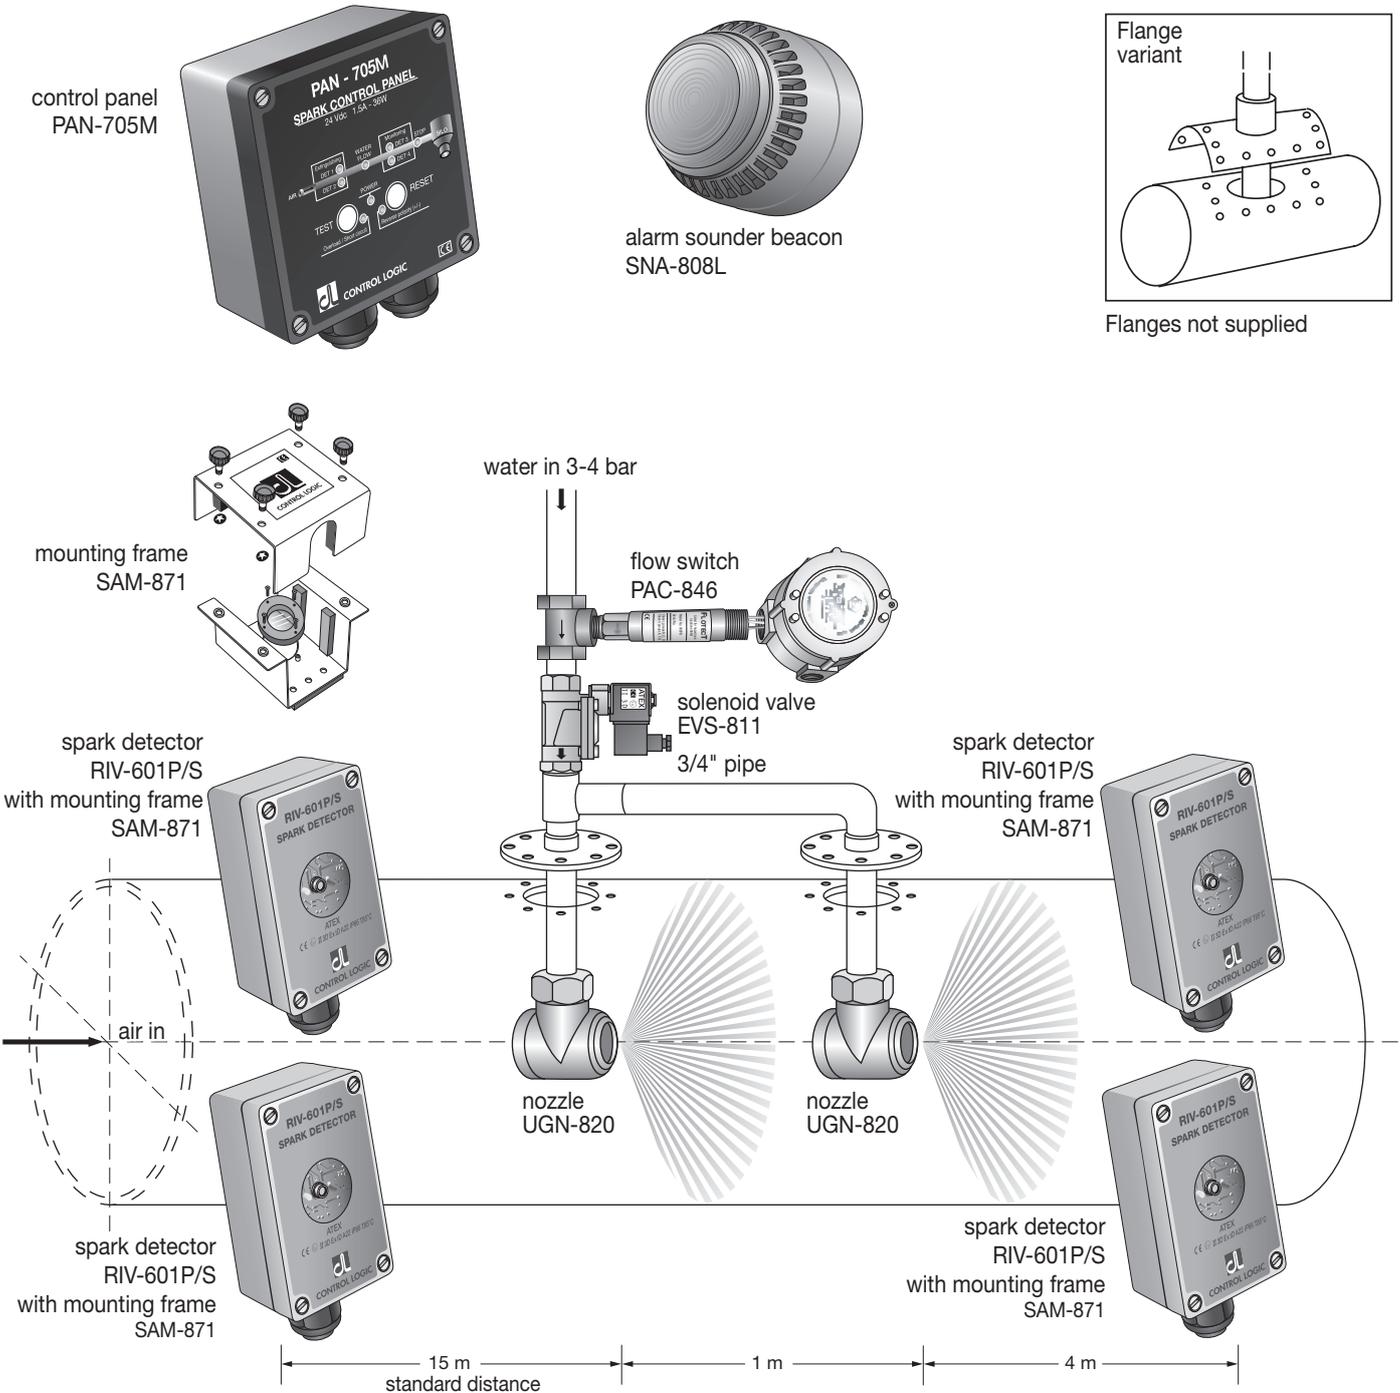

DETECTION

See page MASP 13
 for minimum distance between
 detection and extinguishing

EXTINGUISHING

MONITORING

Note:

After the monitoring station an electro-pneumatic duct valve can be mounted to shut off the duct.