


## SYSTEMS TYPE "A" AND "B" system diagram

System type "A" comprises only one spark detector and one nozzle, and is used for "small" ducts up to 500mm diameter. System type "B" comprises 2 spark detectors and 2 nozzles, and is used for "large" ducts over 500mm diameter.

### Component list:

Type "A"	Type "B"	Component
n. 1	n. 2	RIV - 601P/S Spark detector
n. 1	n. 2	SAM - 871 Mounting frame
n. 1	n. 1	PAN - 705M Control panel
n. 1	n. 1	SNA - 808L Alarm sounder beacon
n. 1	n. 1	EVS - 811 Solenoid valve
n. 1	n. 2	UGN - 820 Spray nozzle
n. 1	n. 1	PAC - 846 Flow switch*

\* PAC is an option to be added to standard "A" and "B" systems

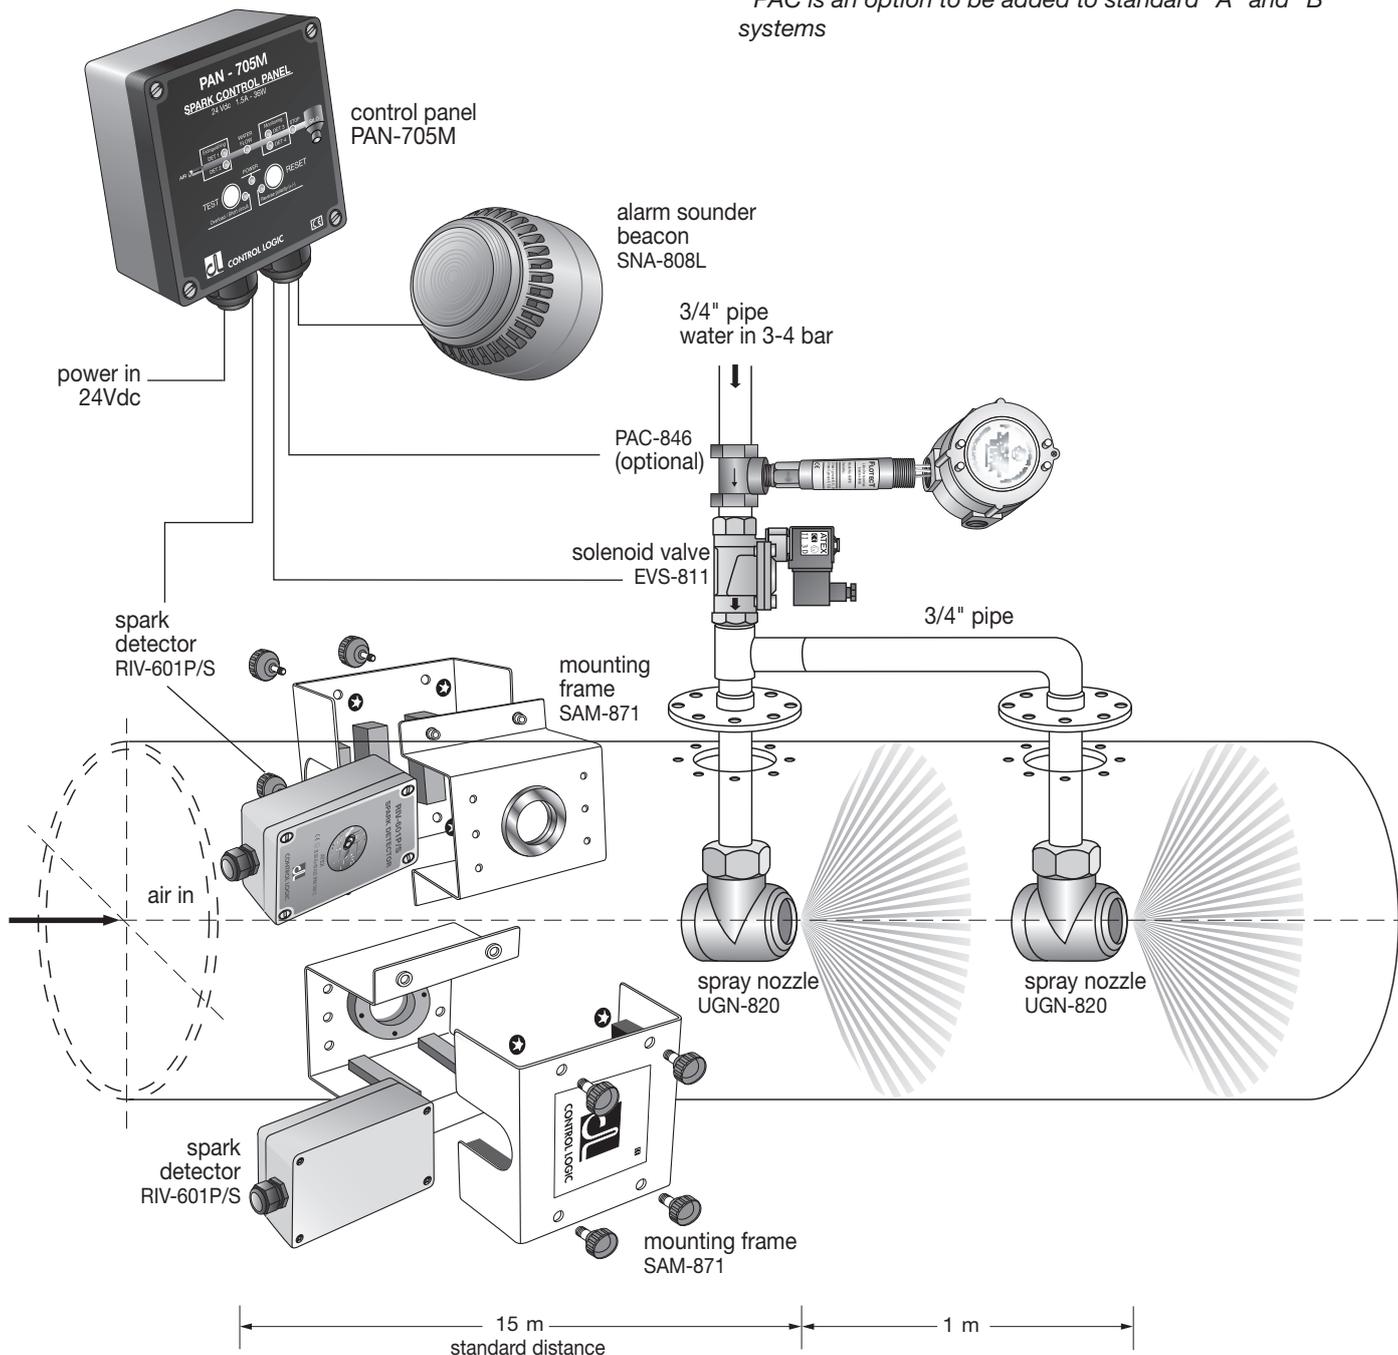

### DETECTION

See page MASP 13  
for minimum distance between  
detection and extinguishing

### EXTINGUISHING